


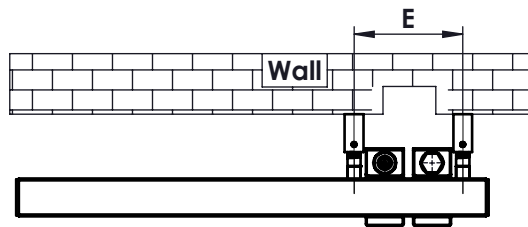


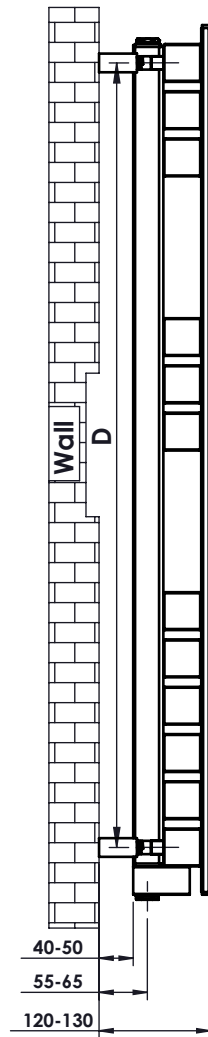


VD 0308 Droite

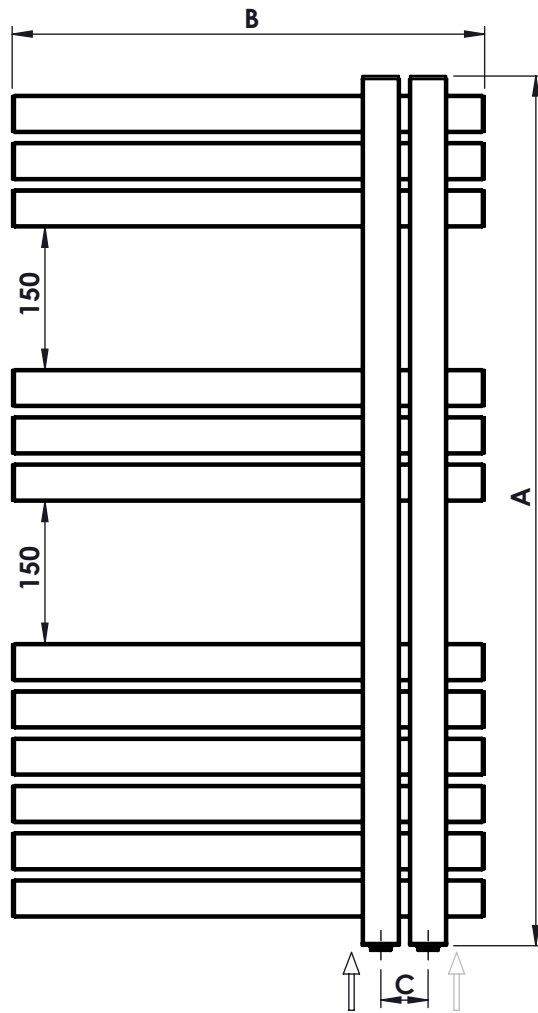

A HEIGHT mm	B LENGTH mm	C PIPE CENTER mm	D VERTICAL BRACKET CENTERS mm	E HORIZONTAL BRACKET CENTERS mm	HEAT OUTPUTS (BTU) Delta T:50°C	HEAT OUTPUTS (WATT) Delta T:50°C
920	500	50	830	115	3197	936
1460	500	50	1370	115	5328	1560



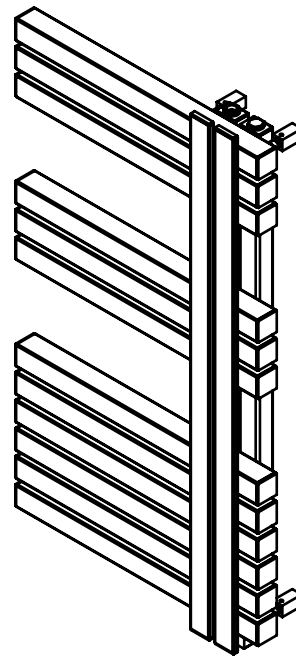


Bracket Assembly


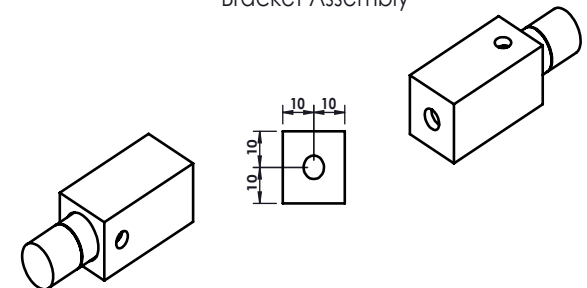





VD 0308 Gauche

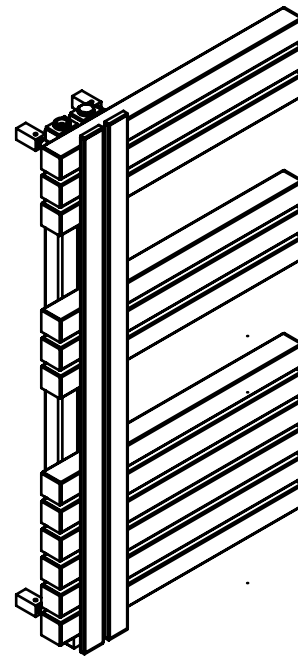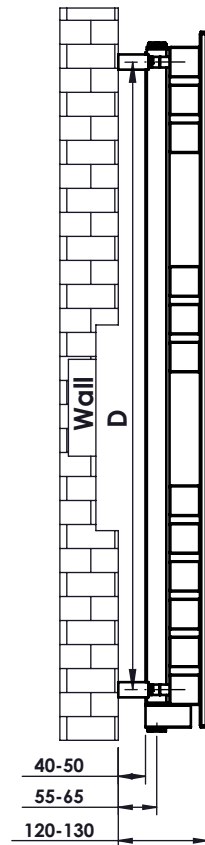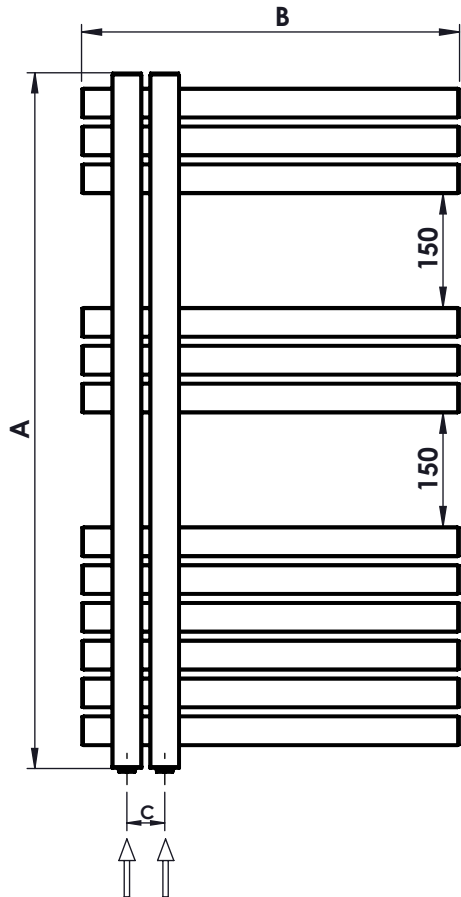

A	B	C	D	E	HEAT OUTPUTS (BTU)	HEAT OUTPUTS (WATT)
HEIGHT mm	LENGTH mm	PIPE CENTER mm	VERTICAL BRACKET CENTERS mm	HORIZONTAL BRACKET CENTERS mm	Delta T: 50 °C	Delta T: 50 °C
920	500	50	830	115	3197	936
1460	500	50	1370	115	5328	1560

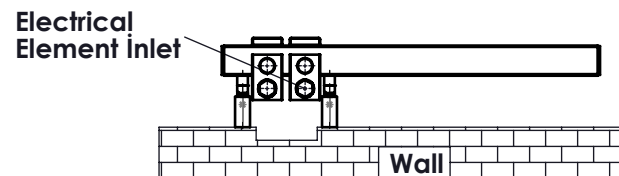
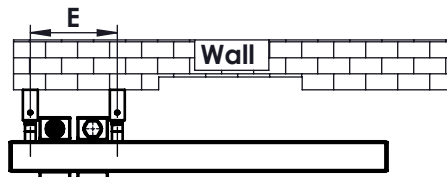


Bracket Assembly


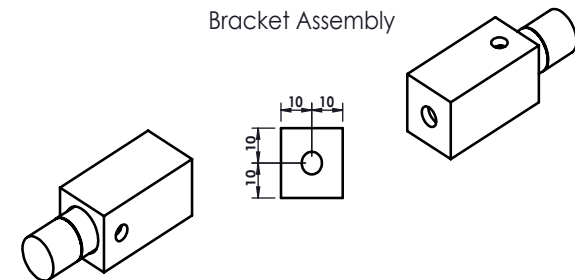




VD 0308 Droite


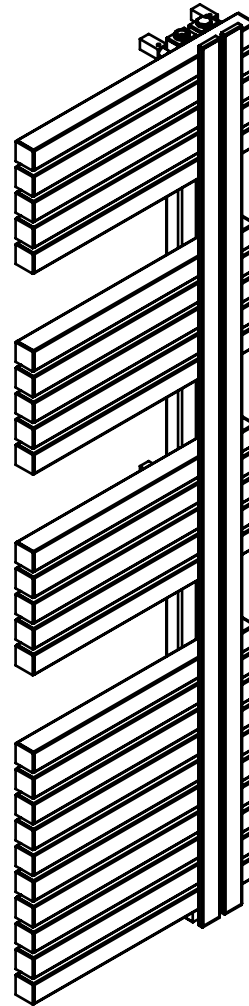
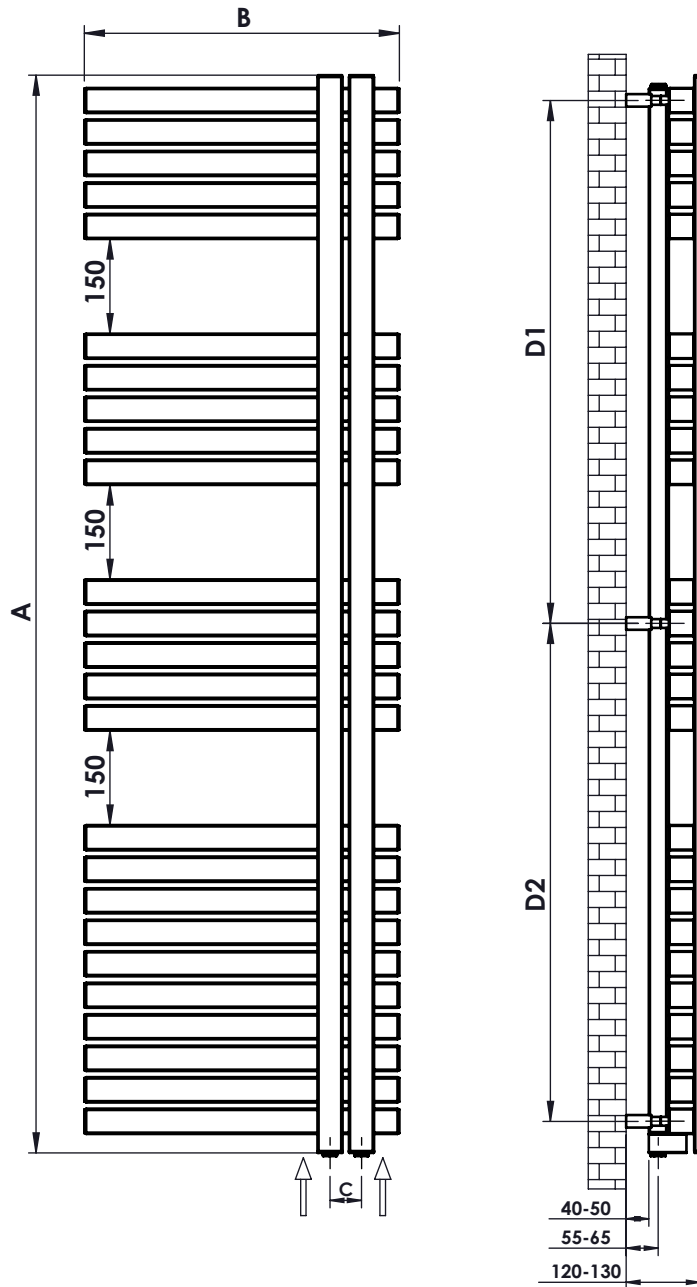


A HEIGHT mm	B LENGTH mm	C PIPE CENTER mm	D1-D2 VERTICAL BRACKET CENTERS mm	E HORIZONTAL BRACKET CENTERS mm	HEAT OUTPUTS (BTU) Delta T:50 °C	HEAT OUTPUTS (WATT) Delta T:50 °C
1710	500	50	830-790	115	6660	1950

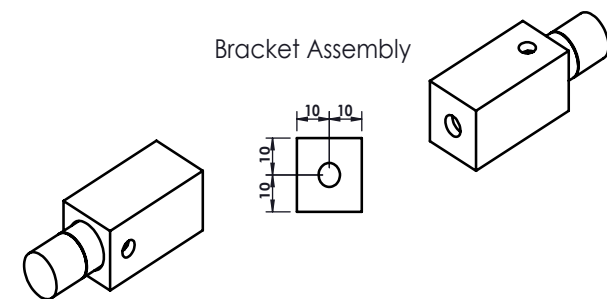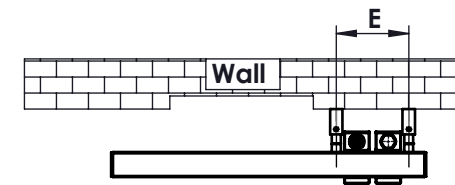




VD 0308 Gauche

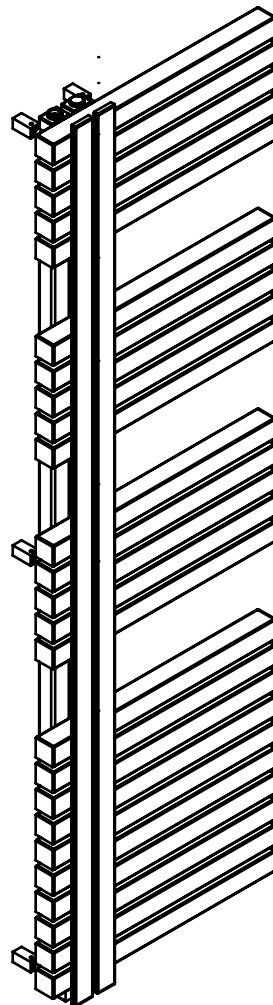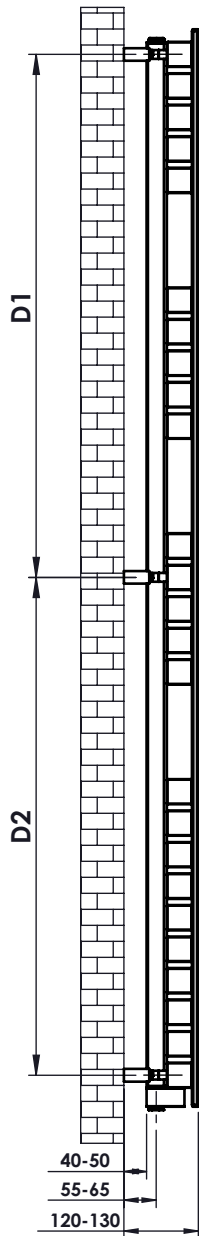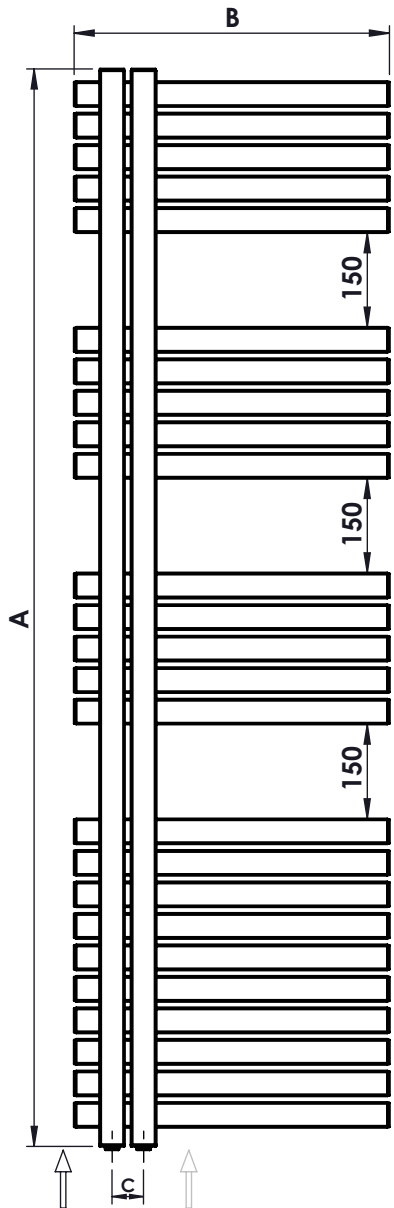

A	B	C	D1-D2	E	HEAT OUTPUTS (BTU)	HEAT OUTPUTS (WATT)
HEIGHT mm	LENGTH mm	PIPE CENTER mm	VERTICAL BRACKET CENTERS mm	HORIZONTAL BRACKET CENTERS mm	Delta T:50 °C	Delta T:50 °C
1710	500	50	830-790	115	6660	1950

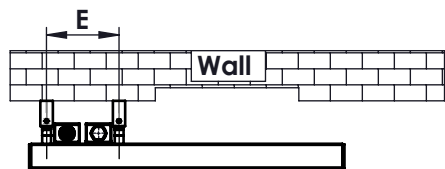

Bracket Assembly

